DZM2 Interconnect Wiring Diagrams

Direct Microphone ICS Interconnections with GMA-340

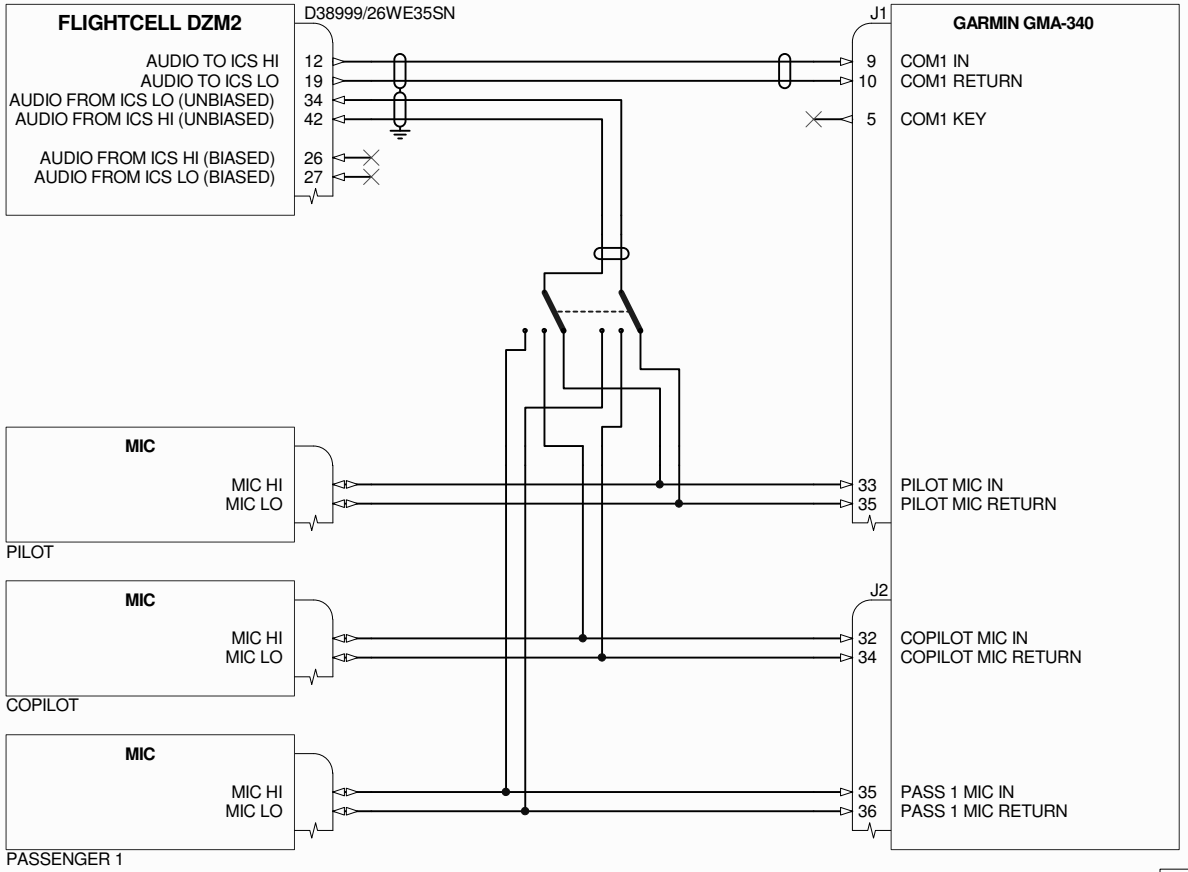

NOTES:

1. ALL POWER CABLES SHOULD BE 22AWG STRANDED UNLESS OTHERWISE NOTED e.g. M22759/34-22-9
   OTHER CABLES SHOULD BE 22AWG STRANDED, SCREENED WHERE INDICATED e.g. M27500/-24SB2T14.
2. IT IS RECOMMENDED THAT THE POWER GROUND CONNECTIONS BE RUN
3. SYMBOL DESIGNATIONS

SHIELDED PAIR
SHIELD TERMINATED TO DC GROUND

SHIELDED PAIR
SHIELD FLOATING

UNIT GROUND

Flightcell International Limited
PO Box 1481, Nelson, New Zealand
Ph:+64 3 545 8652 www.flightcell.com

REV	DESCRIPTION	DATE	APPD
1.1	C/N FCN0312 - Drawing no added, Shielding scheme updated.	07/03/12	JG
1.0	Document created (C/N FCN0224).	20/06/11	JG

Product: Flightcell DZM2
Sheet: Direct MIC ICS Interconnections 1 of 1
Issue: 1.1
Drawn By: James Glasgow
Filename: Direct MIC Connections.SchDoc
Date: 19/06/2012 Drawing No: WRL DZ2 004