


# Remote Head Interconnect Wiring Diagrams

## DZM3 ICD

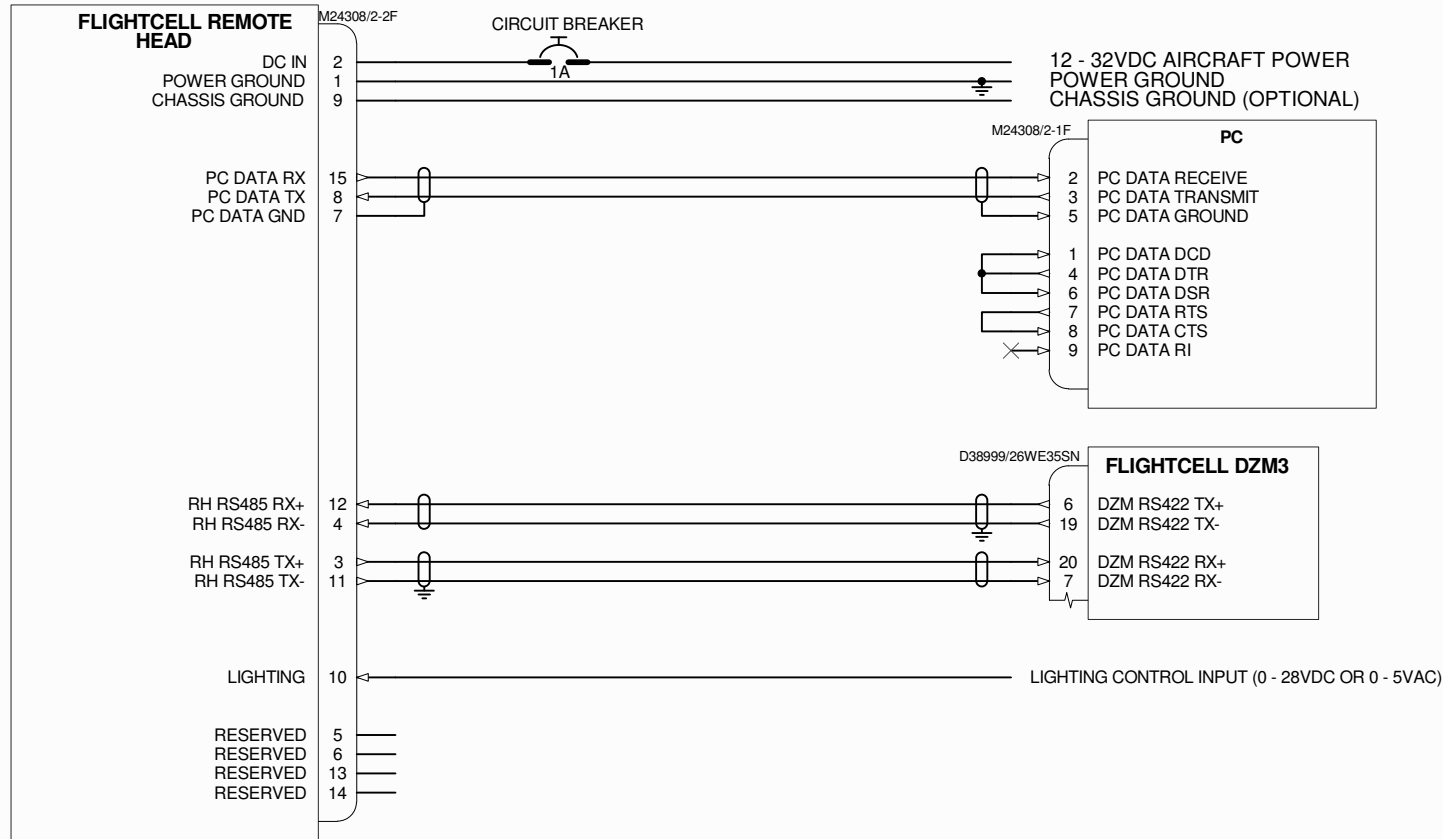

**NOTE:**

It is highly recommended that the PC port be fitted to facilitate in-situ reprogramming of the slave unit firmware.

The lighting input need be fitted only if the display backlight brightness needs to be controlled separately to the DZM. Otherwise the brightness can be set to a fixed level via the menu.

**NOTES:**

- ALL POWER CABLES SHOULD BE 22AWG STRANDED UNLESS OTHERWISE NOTED e.g. M22759/34-22-9  
OTHER CABLES SHOULD BE 22AWG STRANDED, SCREENED WHERE INDICATED e.g. M27500/-24SB2T14.
- IT IS RECOMMENDED THAT THE POWER GROUND CONNECTIONS BE RUN
- SYMBOL DESIGNATIONS

SHIELDED PAIR  
SHIELD TERMINATED TO DC GROUND

SHIELDED PAIR  
SHIELD TERMINATED TO DESIGNATED PIN

SHIELDED PAIR  
SHIELD FLOATING

UNIT GROUND

WIRE SPLICE CONNECTION



Flightcell International Limited  
PO Box 1481, Nelson, New Zealand  
Ph: +64 3 545 8652 www.flightcell.com

Product:	Flightcell Remote Head	Sheet:	DZM3 ICD	1 of 1
Issue:	1.0	Drawn By:	James Glasgow	
1.0	Document created (C/N FCN0360).	18/06/11	JG	
REV	DESCRIPTION	DATE	APPD	Date: 18/06/2012 Drawing No: WRL DZ5 002